


**HILL OF FARE
WIND FARM**

FIGURE 2.8

**TYPICAL
TELECOMMUNICATIONS
MAST**

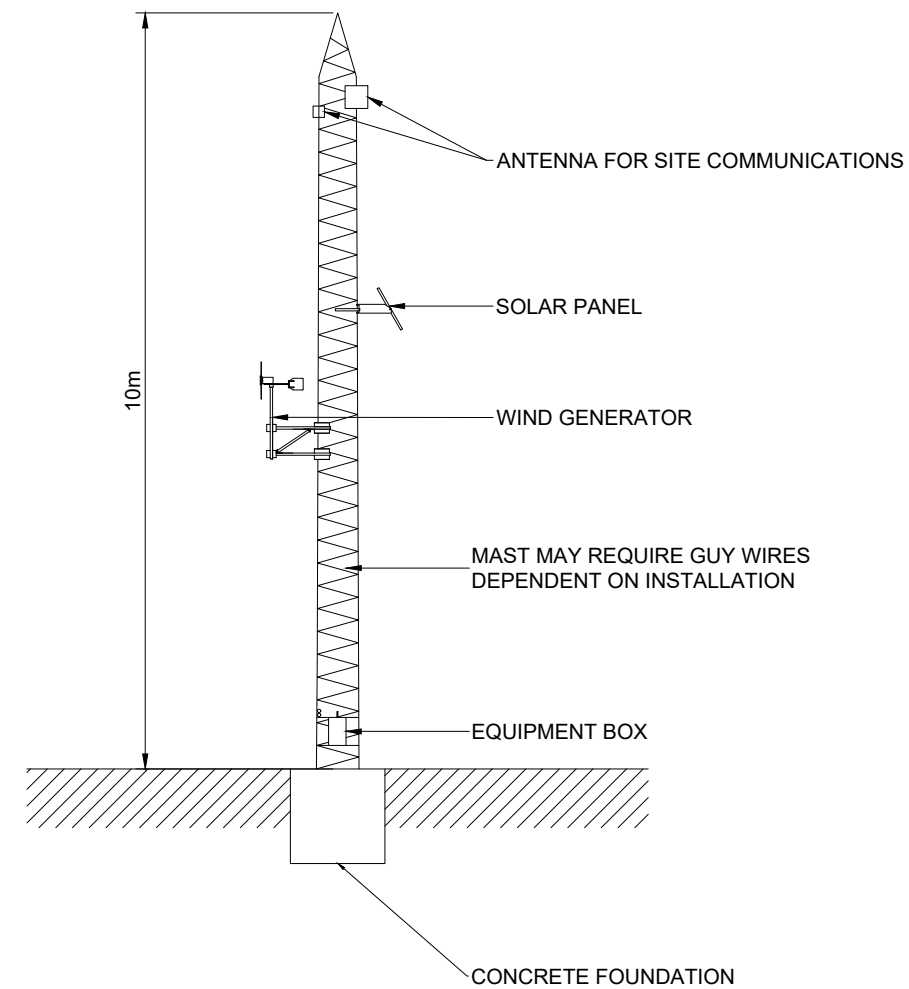

TELECOMMUNICATIONS MAST

NOTES

1. DO NOT SCALE FROM THIS DRAWING.
2. ALL INSTRUMENTATION SHOWN TO PROVIDE INDICATION OF TYPES AND NUMBERS REQUIRED. ACTUAL REQUIREMENTS TO BE CONFIRMED DURING DEVELOPMENT OF DETAILED DESIGN.
3. ALL REQUIRED WIRES NOT SHOWN FOR CLARITY (NUMBER AND LOCATION OF GUY WIRES TO BE CONFIRMED).
4. ALL GUY WIRES TO EXTEND TO AND BE ANCHORED AT GROUND LEVEL.
5. THE TELECOMMUNICATIONS MAST WILL BE LOCATED WITHIN THE SUBSTATION COMPOUND.

LAYOUT DWG	N/A	T-LAYOUT NO.	N/A
------------	-----	--------------	-----

DRAWING NUMBER	04542-RES-CTL-DR-PT-001	REV	1
----------------	-------------------------	-----	---

SCALE - 1:100 @ A3

**ENVIRONMENTAL IMPACT
ASSESSMENT REPORT 2023**

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION